# **CAL MAXVU RAIL**

Temperature Controller / Transmitter

Datasheet



# 2000°

# **Overview**

MAXVU Rail temperature and process controller is a behind panel DIN-rail mounted device that's easy to install and fast to setup with an easy to read OLED display.

MAXVU Rail provides an affordable solution where essential temperature controller is required, it offers a universal input and up to 3 outputs.

The unit also has a transmitter mode disabling control for temperature and process measurement applications.

# **Specification**

#### Input

Thermocouple J, K, C, R, S, T, B, L, N.

• 3 Wire PT100

**DC Linear** 0 to 20mA, 4 to 20mA, 0 to 50mV, 10 to 50mV, 0 to

5V, 1 to 5V, 0 to 10V, 2 to 10V.

Scalable -1999 to 9999, with adjustable dec point

Accuracy

Thermocouple ±0.25% of full range ±1 LSD (±1°C)

for thermocouple CJC). PT100 ±0.25% of full

range, ±1LSD, Linear±0.25% of full range, ±1LSD.

Sampling 4 per second

**Impedance** >10M $\Omega$  resistive, except DC mA (5 $\Omega$ ) and V

 $(47K\Omega)$ 

Sensor Break <2 seconds (except zero based DC ranges), high alarms activate for T/C, RTD and mV ranges, low

alarms activate for mA or V ranges

Digital Input Reset Alarm, Control enable/disable, Auto/

Manual control, Tune start/stop. Volt Free or TTL

compatible, 24VDC

### **Outputs & Options**

Relay OUT1 SPDT Form C, OUT2 / 3 SPST Form A

relay; current capacity 2A at 250V. >150,000

operations at rated voltage/current, resistive load

SSR Drive capability >10V DC @ 20mA

Current output  $500\Omega$  max, Voltage output  $500\Omega$  min

**Serial** 

Communications 2 Wire RS485, 1,200 to 38,400 baud, Modbus RTU

#### At a Glance

- DIN rail mounted
- PID or ON/OFF control
- Universal input
- Up to 3 outputs
- Digital Input
- RS485 communications option
- Transmitter mode
- Fast configuration
- Clear OLED display
- 22.5mm module width

### **Key Features**

- Text / Icon matrix display
- Quick setup menu with main configuration parameters
- Thermocouple, PT100 or linear DC sensor input
- Up to 3 outputs; relay, SSR or Linear DC
- Isolated Digital input
- High/low, deviation or band alarms
- 3 button operation
- 3 status LEDs
- Front panel configuration or via PC configuration software
- RS485 Modbus RTU communications
- Spring terminal option available

### **Specification**

#### **Operating and Environmental**

Temperature & RH 0 to 55°C (-20 to 80°C storage), 20% to 95% RH non-condensing

Altitude • <2000m

**Power Supply** 100 to 240V ±10%, 50/60Hz, 9VA(mains powered version)

24V DC/AC +10%/-15%, AC 50/60Hz, 5W (low voltage version)

Enclosure Protection • IP20

Standards • CE, UL\* & cUL\*


**EMI** • Complies with EN61326-1 (Susceptibility & Emissions)

Safety : Complies with EN61010-1 & UL61010-1
Considerations : Pollution Degree 2, Installation Category II


Weight 0.20kg excluding packaging

**Communications** RS485 Modbus RTU communication option

#### **Dimensions**

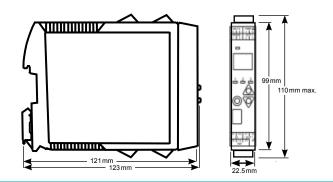

## **Ordering Code**

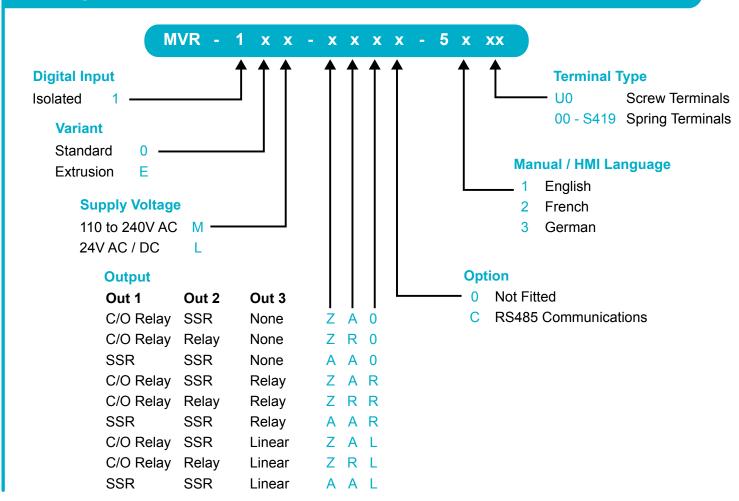

<sup>\*</sup>UL not valid for Spring Terminal version

#### **Accessories**

#### **MAXVU** Configuration software

For PC setup MAXVU configuration software is available free of charge from www.west-cs.co.uk.

A USB configuration adaptor is also available from your local WCS distributor.



MAXVU configuration software is simple to use for fast set up of MAXVU devices.



Set-up wizard simplifies the set-up further.

Provides step-by-step guidance to device configuration with detailed assistance on each setting.



Clear and logical side tabs make it easy to find parameter settings in tabular form.

Simple icon driven taskbar along top for all main functions



Each parameter shows current setting and can easily be changed by drop-down menus or entering values.

Allowable setting range is shown for guidance.

A useful help box provides additional assistance.

#### **Contact**



Email: enquiries@west-cs.com

Website: www.west-cs.co.uk



Telephone: +44 (0)1273 606271

**Fax:** +44 (0)1273 609990



Address: The Hyde Business Park

Brighton, East Sussex

BN2 4JU

United Kingdom

